

Elements of Electrical Power Station Design

M.V. Deshpande

Chapter 8

Example Problem 8.6 Page 227.

At a site for hydro-electric power project, a flow of $90\text{m}^3/\text{s}$ is available at a head of 100m. Sufficient storage is available. A hydro-electric power plant is to be chosen for the project.

Load factor of power system supplied by the station 80%

Cost of the hydro development \$1500 per kW installed

Fixed cost 9%

Operation and maintenance cost \$7 per kW per yr

Load centre is 80km from power station

Transmission line voltage to load centre 110kV

Transmission liability \$20 per kW per yr

Energy used in generating stations for auxiliaries 2%

Efficiency of turbines 89.5%

Efficiency of generators 95

$Q := 90 \frac{\text{m}^3}{\text{s}}$ discharge rate

$w := 1000 \frac{\text{kg}}{\text{m}^3}$ density of water

$n_t := 0.895$ efficiency of turbine(s)

$h := 100 \text{ m}$ head

a) Find the power that could be developed, the number of units required, and the capacities of the turbines and generators. Efficiency of turbines 89.5% and generators 95%

Power that could be developed:

$$P_t := \frac{(Q \cdot w \cdot h \cdot n_t)}{75} \quad P_t = (107.4 \cdot 10^3) \frac{\text{kg} \cdot \text{m}}{\text{s}} \quad \text{metric h.p.}$$

Load_Factor := 80% Load Factor = Average load / Maximum load

80% load factor does not show much variation of load. So 2 turbines can be chosen for the power station each carrying $P_t/2$.

$$\text{Turbine_load} := \frac{P_t}{2} \quad \text{Turbine_load} = (53.7 \cdot 10^3) \frac{\text{kg} \cdot \text{m}}{\text{s}}$$

Generator capacity based on each turbine load:

One_hp := 0.736 kW Converting hp to kW

$n_g := 0.95$ generator efficiency

Generator_capacity := Turbine_load • n_g • One_hp

$$\text{Generator_capacity} = (37.547 \cdot 10^6) \frac{\text{kg}^2 \cdot \text{m}^3}{\text{s}^4} \quad \text{MW}$$

$P_{\text{tot_delivered}} := 2 \cdot \text{Generator_capacity}$

$$P_{\text{tot_delivered}} = (75.094 \cdot 10^6) \frac{\text{kg}^2 \cdot \text{m}^3}{\text{s}^4} \quad \text{MW}$$

b). Specifications for the turbines and generators

Each turbine output is 53,700 metric hp

Head at 100m

Turbine type: Use fixed blade Francis turbine.

Calculate the specific speed of the turbine(s):
 Equation 8.4 - Francis Turbine page 208

$$n_s := \frac{6850}{\left(\left(\frac{h}{m} \right) + 9.8 \right)} + 84 \quad n_s = 146.386 \quad \text{rpm}$$

h divided by m (meters)
 to make the units work
 (Mechanical units and
 Mathcad does units
 automatically)

The corresponding actual speed:
 Use equation 8.2 page 207

$P_{\text{turb}} := \text{Turbine_load}$

$$n := \frac{n_s \cdot h^{\left(\frac{5}{4}\right)}}{P_{\text{turb}}^{\left(\frac{1}{2}\right)}} \quad n = 199.762 \frac{\text{m}^{\frac{3}{4}} \cdot \text{s}^{\frac{1}{2}}}{\text{kg}^{\frac{1}{2}}} \quad \text{rpm}$$

The synchronous speed of a generator is $n = 120f/p$ rev per min
 f is the frequency, p is the number of poles. Use a 30 pole machine.

$f := 50 \quad \text{Hz}$ $p_{\text{pole}} := 30$

$$n_g := 120 \cdot \frac{f}{p_{\text{pole}}} \quad n_g = 200 \quad \text{rpm}$$

Now returning to correcting the specific speed by rearranging equation 8.2

$$n_{s_new} := \frac{n_g \cdot \left(P_{turb}^{\frac{1}{2}} \right)}{h^{\frac{5}{4}}}$$

$$n_{s_new} = 146.561 \frac{\text{kg}^{\frac{1}{2}}}{\text{m}^{\frac{3}{4}} \cdot \text{s}^{\frac{1}{2}}}$$

$n_{s_new} := 146.561$ manually entered to simplify calculation below with regards to units

n_{s_new} is not very much different from n_s calculated earlier

$$\text{difference_ns_nsnew} := \left| \frac{n_s - n_{s_new}}{n_s} \right| = 0.0012$$

See page 223 paragraph 3 on vertical and horizontal shaft suggestions.

A suitable generator specification:

1. vertical axis
2. 36,500 kW minimum
3. 0.9 power factor
4. 41.67 kVA (36500/0.9=40,560VA)
5. 200 rpm
6. star connected stator
7. 11kV
8. 3 phase
9. 50Hz
10. 60 degree temperature rise
11. air cooling for small generator
12. exciter requirements see section 8.8.1 Exciters for hydro-generators; page 220

c). Calculate the main dimensions of the turbine units

Using Table 8.1 'Dimensions of 1 hp (metric) wheel operating under 1 meter of head for reaction turbines only'.

For specific speed n_s of 146.6, interpolating for the correct dimensions

$$D_1 := 102 - \left(\frac{(102 - 78.5)}{180 - 135} \cdot (146.6 - 135) \right) = 95.942$$

$$D_2 := 94 - \frac{(94 - 83.5)}{180 - 135} \cdot (146.6 - 135) = 91.293$$

Calculate width of distribution WD:

$$WD := 17.8 + \frac{(19.5 - 17.8)}{180 - 135} \cdot (146.6 - 135) = 18.238$$

Calculate model ratio m:

$$m_ratio := \frac{P_{turb}^{\frac{1}{2}}}{2.46 \cdot h^{\left(\frac{3}{4}\right)}} \qquad m_ratio = 2.979 \frac{\text{kg}^{\frac{1}{2}}}{\text{m}^{\frac{1}{4}} \cdot \text{s}^{\frac{1}{2}}}$$

m_ratio := 2.979 manual entry to simply units in calculations below

The final dimensions after calculating m:

$$D_{1new} := D_1 \cdot m_ratio = 286 \quad \text{cm}$$

$$D_{2new} := D_2 \cdot m_ratio = 272 \quad \text{cm}$$

$$WD_{new} := WD \cdot m_ratio = 54 \quad \text{cm}$$

d). Calculate main dimensions of generator unit(s):

The general expression for the output of a generator as developed in chapter 3, equation 3.23, holds for hydro-generators.

$$B := 6.5 \cdot 10^{-5} \quad \text{weber/cm}^2$$

$$a_c := 400 \quad \text{ampere conductors per centimeter of periphery}$$

$$n_{g_seconds} := \frac{n_g}{60} \quad \text{rps (rev per second)}$$

Rearranging eq. 3.23 to solve for (D^2)L

$$S := \frac{36500}{0.9} = 40.56 \cdot 10^3 \quad \text{kVA}$$

$$D_{sqrd}L := \frac{S}{(10.4 \cdot 10^{-3}) \cdot B \cdot a_c \cdot n_{g_seconds}} \qquad D_{sqrd}L = 44.995 \cdot 10^6 \quad \text{cm}^3$$

$$\text{Let } D^2(L) = x$$

Choose a core length L equal to pole pitch

$$D^2 = x/L$$

$$\text{Also } x = (\pi)D/p$$

$$\text{Now equate both } x; \quad x = D^2(L) = (\pi)D/p$$

$$\text{Rearranging} \quad xp/(\pi)D = D^2(L)$$

$$D^3 = xp/(\pi)$$

$$\text{So} \quad x := D_{\text{sqrd}}L = 44.995 \cdot 10^6$$

$$D_{\text{cube}} := \frac{x \cdot p_{\text{pole}}}{\pi} \quad D_{\text{cube}} = 429.671 \cdot 10^6 \quad \text{cm}^3$$

$$D := \sqrt[3]{D_{\text{cube}}} \quad D = 754.6 \quad \text{cm}$$

Solving for L:

$$x/L = x(p)/(\pi)D$$

$$L = (\pi) D / p < \text{----- This is the pole pitch}$$

$$L := \pi \cdot \frac{D}{p_{\text{pole}}} \quad L = 79.021 \quad \text{cm approximately}$$

Calculate the peripheral speed:

$$S_{\text{peripheral}} := (\pi \cdot D \cdot 10^{-2}) n_g \quad D \text{ converted from cm to m, times } 10^{-2}$$


$$S_{\text{peripheral}} = 4741.24 \quad \text{m/min}$$

Page 222 Paragraph 5- The peripheral speed limit may be taken as between 3500 and 5000 m/min.

Peripheral speed at 4741.24 is between 3500 and 5000, so it is permissible.

$$D = 755 \quad \text{cm} \quad L = 79 \quad \text{cm}$$

e). Determine the draft tube areas at inlet and outlet

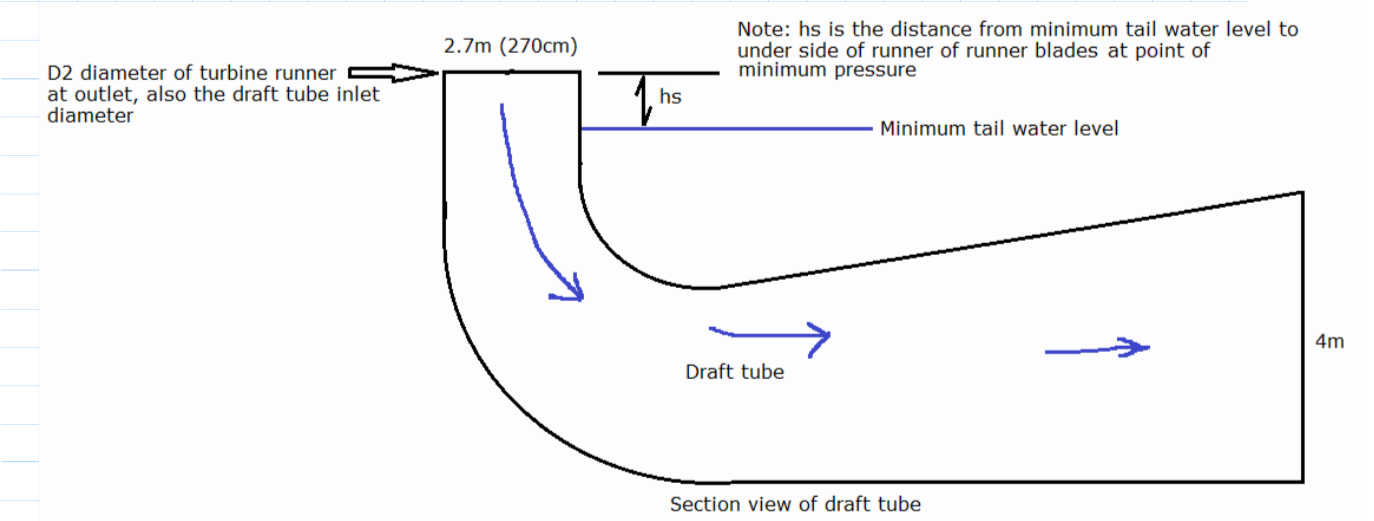

Note: h_s is the distance from tailwater to underside of runner blades at point of minimum pressure

The flow of $90\text{m}^3/\text{s}$ is divided by 2 since the discharge is split in two.

$$Q_1 := \frac{Q}{2} \quad Q_1 = 45 \frac{\text{m}^3}{\text{s}}$$

Diameter of turbine runner at outlet D_2 , is the diameter at inlet of draft tube.

$$D_{2_{\text{new}}} = 271.963 \quad \text{cm}$$

$$D_{2_{\text{m}}} := \left(\frac{D_{2_{\text{new}}}}{100} \right) \text{m} \quad \text{convert to meters}$$

Flow divided by area equal to velocity

Velocity at inlet of draft tube v_2 :

$$v_2 := \frac{Q_1}{\left(\frac{\pi}{4} \right) \cdot D_{2_{\text{m}}}^2} \quad v_2 = 7.746 \frac{\text{m}}{\text{s}}$$

Page 216 permissible velocities at inlet and outlet of draft tube:

For high specific speeds at outlet - -> $0.0325 \sqrt{2gh}$

Velocity at outlet of draft tube v3:

$$\text{gravity} := 9.81 \frac{\text{m}}{\text{s}^2} \quad h = 100 \text{ m}$$

$$v_3 := 0.0325 \cdot (\sqrt{2 \cdot \text{gravity} \cdot h}) = 1.44 \frac{\text{m}}{\text{s}}$$

For safety factor we will use $\rightarrow 0.003 \sqrt{2gh}$

$$v_3 := 0.03 \cdot (\sqrt{2 \cdot \text{gravity} \cdot h}) = 1.329 \frac{\text{m}}{\text{s}}$$


Let $v_3 = 1.25 \text{ m/s}$ this will create a larger water exit cross section area
Area at exit = Q_1/v_3

$$v_3 := 1.25 \frac{\text{m}}{\text{s}}$$

$$\text{Area}_{\text{exit}} := \frac{Q_1}{v_3} \quad \text{Area}_{\text{exit}} = 36 \text{ m}^2 \quad \text{Whole number and easily made into a square area of whole distances}$$

We choose a cross section area of 4 x 6 meters
 $4 \text{ m} \times 6 \text{ m} = 36 \text{ m}^2$.

With a central pier of 2m wide. Pier is solid no flow thru it.
The draft tube end section dimension will be 4m x 11m.

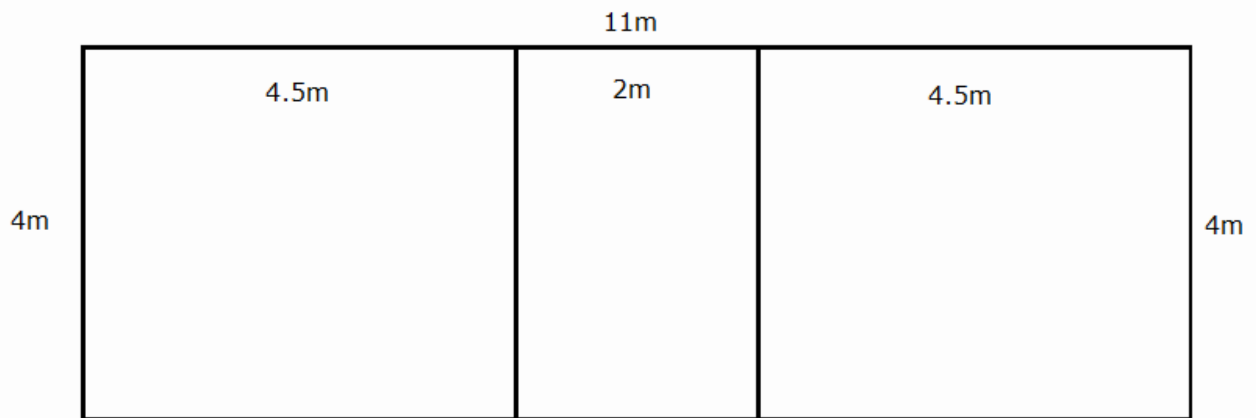

End view (water discharged from draft tube)

Using a quarter turn draft tube. We have 2 sets of turbines and each has two flares.
The discharge from the runner is flared into two. So for this power station with 2 sets of turbines there are a total of 4 flares.

Length of draft tube:

$$L_{\text{draft_tube_at_exit}} := 11 \text{ m}$$

$$L_{\text{draft_tube_inlet}} := D_{2_m} = 2.72 \text{ m}$$

$$\text{Length_draft_tube} := \left(\frac{L_{\text{draft_tube_at_exit}} - L_{\text{draft_tube_inlet}}}{2} \right) \cdot 4$$

$$\text{Length_draft_tube} = 16.561 \text{ m} \quad 4 \text{ tubes in parallel total length}$$

f). Determine the setting of the turbine, h_s , with respect to the tail water

$$n_s = 146.386$$

Use figure 8.13a for obtaining the cavitation coefficient; page 216.

Cavitation Coefficient = 0.065

$$\sigma := 0.068$$


h_b is the barometric pressure head at elevation of runner above mean sea-level

$$h_b := 7.62 \text{ m}$$

$$h_s := h_b - (\sigma \cdot h) = 0.82 \text{ m}$$

The turbine is set at 0.82 meters above the tail water level.

See figure 8.2 (top) page 201.

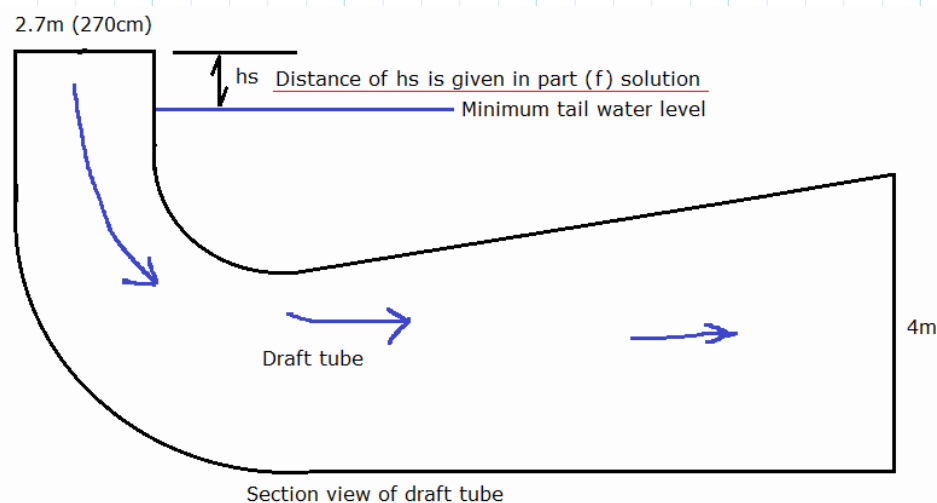


g). Find the approx. dimensions of scroll case for each unit:

The scroll case is generally made of plate steel. Its purpose is convert the pressure head gradually into higher velocities, before water enters the turbine runner. Its dimension are related to a certain extent to the inlet diameter of the draft tube or the outlet diameter of

the turbine runner.

See the figure below for the scroll case dimension sizing.

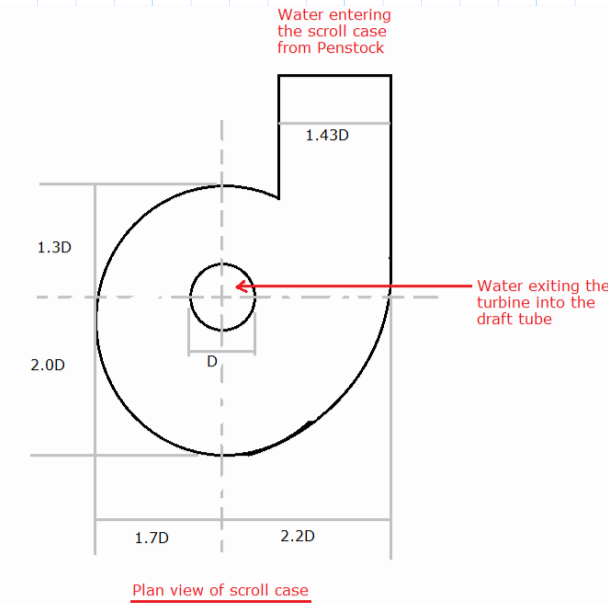

Diameter D in figure above is the draft tube inlet diameter D_2 in meters.

$$D_{2,m} = 2.72 \text{ m}$$

$$1.47 \cdot D_{2,m} = 3.998 \text{ m}$$

$$1.30 \cdot D_{2,m} = 3.536 \text{ m}$$

$$2.00 \cdot D_{2,m} = 5.439 \text{ m}$$

$$1.7 \cdot D_{2,m} = 4.623 \text{ m}$$

$$2.2 \cdot D_{2,m} = 5.983 \text{ m}$$

h). Determine the main dimensions of penstock for each unit:

Velocity through each penstock allowed is between 2 to 6 m/s
So for this problem all a velocity through the penstock of 4m/s

There are 2 penstocks, with each having 2 flared draft tubes.

Area of penstock from flow and velocity:

$$V_{\text{pen}} := 4 \frac{\text{m}}{\text{s}} \quad Q_1 = 45 \frac{\text{m}^3}{\text{s}}$$

$$\text{Area_penstock} := \frac{Q_1}{V_{\text{pen}}} \quad \text{Area_penstock} = 11.25 \text{ m}^2$$

Diameter of penstock = $\text{Sqrt}(\text{Area} \times 4)/\pi$

$$D_{\text{pen}} := \sqrt{\frac{(\text{Area_penstock} \cdot 4)}{\pi}}$$

$$D_{\text{pen}} = 3.785 \text{ m} \quad D_{\text{pen_cm}} := D_{\text{pen}} \cdot \frac{100}{\text{m}} = 378.47 \text{ cm}$$

Thickness of penstock $t = (0.1 \times h \times d)/((2 \times f \times \eta_j))$

t = thickness of penstock

h = head in meters

d = diameter of penstock in cm

η_j = joint efficiency

f = permissible stress in kg/cm^2

Permissible stress f 950 kg/cm^2 with static head alone

If water hammer is included f is 1125 kg/cm^2

Joint efficiency if riveted 80%, if welded up to 90%

$$f_{\text{stress}} := 1000 \frac{\text{kg}}{\text{cm}^2} \quad \eta_j := 90\% \quad h_{\text{cm}} := h \cdot \frac{100}{\text{m}} = 1 \cdot 10^4$$

All the units are in cm

$$t := \frac{(0.1 \cdot h_{\text{cm}} \cdot D_{\text{pen_cm}})}{2 \cdot f_{\text{stress}} \cdot \eta_j} \cdot \left(\frac{\text{kg}}{\text{m}^2} \right) \quad t = 0.021 \text{ m}$$

$$t_{\text{cm}} := t \cdot 100 \quad t_{\text{cm}} = 2.103 \text{ cm}$$

Adding for corrosion of 0.15cm, ie 0.0015m

$$\text{Corr}_{\text{adj}} := 0.0015$$

$$t_{\text{final}} := t + \text{Corr}_{\text{adj}} = 0.023$$

$$t_{\text{final_cm}} := t_{\text{final}} \cdot 100 = 2.253 \text{ cm}$$

The penstock diameter is 348.47cm and thickness is 2.253cm.

i). Suggest a preliminary plan layout of the station units,
and find the approximate dimensions of the main floor of the buildings

Using figure 8.14 page 224, with $n_s = 146 \text{ rpm}$, X is approximately equal to 4.75

$$X := 4.75$$

$$\text{Dist}_{\text{cntr_cntr}} := D_{2_m} \cdot X$$

$$\text{Dist}_{\text{cntr_cntr}} = 12.918 \text{ m}$$

Make it a whole number for the distance, manual entry below


$$\text{Dist}_{\text{cntr_cntr}} := 13 \text{ m}$$

Lets to a check from the scroll case major dimensions, and allowing at least 2m between units:

$$1.7 \cdot D_{2_m} + 2.2 \cdot D_{2_m} + 2 \text{ m} = 12.607 \text{ m}$$

The distance can be set at 13m as per using X above.

Applying the distances of the scroll case, generator spacings, space to work around equipment, with erection bay 1.5 times the operations bay, the final room size is shown in the figure below at 50m x 30m. Its an approximation for intended preliminary design.

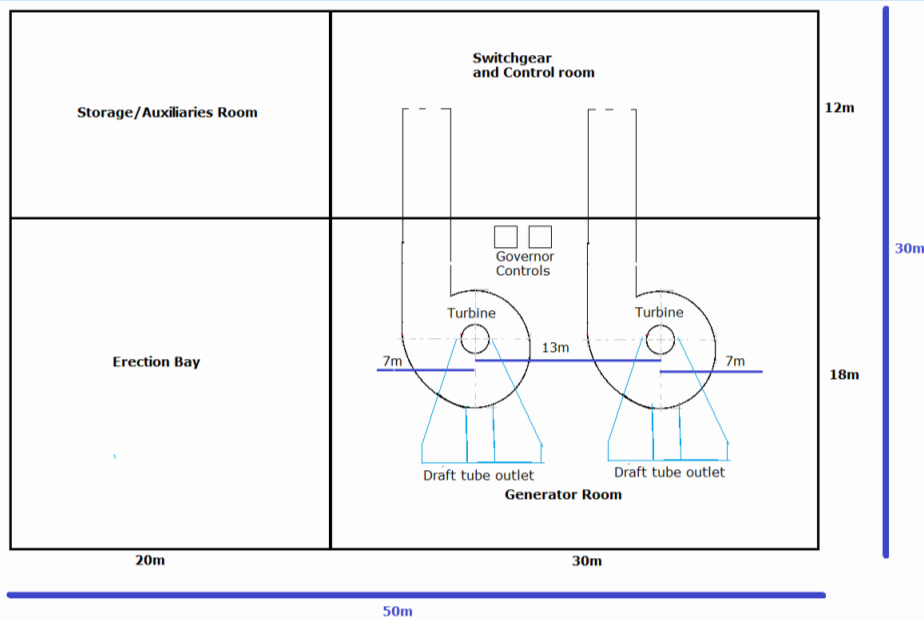

j). Find the cost of energy per kilowatt-hour at the load centre from the data given below.

Load factor of power system supplied by the station 80%

Cost of the hydro development \$1500 per kW installed

Fixed cost 9%

Operation and maintenance cost \$7 per kW per yr

Load centre is 80km from power station

Transmission line voltage to load centre 110kV

Transmission liability \$20 per kW per yr

Energy used in generating stations for auxiliaries 2%

Efficiency of turbines 89.5%

Efficiency of generators 95

Set the variables below:

LF := 0.8 ie 80%

Cost_{dev_perkw} := 1500

Fixed_{costperkw} := 0.09 ie 9%

OperMant_Cost_{perkwperyr} := 7

Load_Cntr_dist := 80

TransLine_volt := 110000

TransLineLiability_{perkwperyr} := 20

Aux_Energy := 0.02 ie 2%

$$P_{\text{tot_delivered}} = (75.094 \cdot 10^6) \frac{\text{kg}^2 \cdot \text{m}^3}{\text{s}^4}$$

From calculations earlier the total capacity of the power station is 75MW (75,000kW)

PwrSt_capacity := 75000 kw **Here we want to keep the numeral at kW because the costs are rated at per kW (75000 <-kW)**

The fixed cost is the 9% of the capital cost per kw of the total power capacity

FixedCost\$:= Fixed_{costperkw} • Cost_{dev_perkw} • PwrSt_capacity

FixedCost\$ = 10.13 • 10⁶ Fixed cost is 9% of capital cost

OperMaintenanceCost\$:= OperMant_Cost_{perkwperyr} • PwrSt_capacity

OperMaintenanceCost\$ = 525 • 10³ Cost to operate and maintain yearly

TransmissionLiabilityCost\$:= TransLineLiability_{perkwperyr} • PwrSt_capacity

TransmissionLiabilityCost\$ = 1.5 • 10⁶

Total annual costs of power station:

$$\text{TotalAnnualCost\$} := \text{FixedCost\$} + \text{OperMaintenanceCost\$} + \text{TransmissionLiabilityCost\$}$$

$$\text{TotalAnnualCost\$} = 12.15 \cdot 10^6 \quad \$$$

Electrical Energy Generated Per year:

$$\text{Hours per year:} \quad \text{HoursPerYear} := 24 \cdot 365 = 8760 \quad \text{Hours}$$

$$\text{ElectricalEnergyPerYear} := \text{PwrSt_capacity} \cdot \text{HoursPerYear} \cdot \text{LF}$$

$$\text{ElectricalEnergyPerYear} = 525.6 \cdot 10^6 \quad \text{kWh}$$

Energy used in station for auxiliaries per year (2%)

$$\text{EnergyUsedForAux} := \text{ElectricalEnergyPerYear} \cdot \text{Aux_Energy}$$

$$\text{EnergyUsedForAux} = 10.512 \cdot 10^6 \quad \text{kWh}$$

Energy available at load centre per year:

$$\text{EnergyAvailableLoadCntr} := \text{ElectricalEnergyPerYear} - \text{EnergyUsedForAux}$$

$$\text{EnergyAvailableLoadCntr} = 515.088 \cdot 10^6 \quad \text{kWh}$$

Cost of energy at load center:

This is equal to total annual cost divided by energy available at load center and its given in cents instead of dollars per kWh.

$$\text{ConvertToCents} := 100$$

$$\text{CostAtLoadCenter} := \left(\frac{\text{TotalAnnualCost\$}}{\text{EnergyAvailableLoadCntr}} \right) \cdot \text{ConvertToCents}$$

$$\text{CostAtLoadCenter} = 2.359 \quad \text{Cents.}$$

In this problem transmission line loss was not given, when given then the net energy available for sale can be determined and the cost worked out.

Sometimes for estimate of transmission line cost percentage of capital cost at 12% is used. Refer to page 225.